


Modbus RTU/tcp On-line simulation


一. Modbus rtu On-line simulation

1. Create a new project, add a modbus RTU device, add numeric inputs, buttons and other components.

2. After compiling the project, click the Online Simulation button , then you can simulate it online.

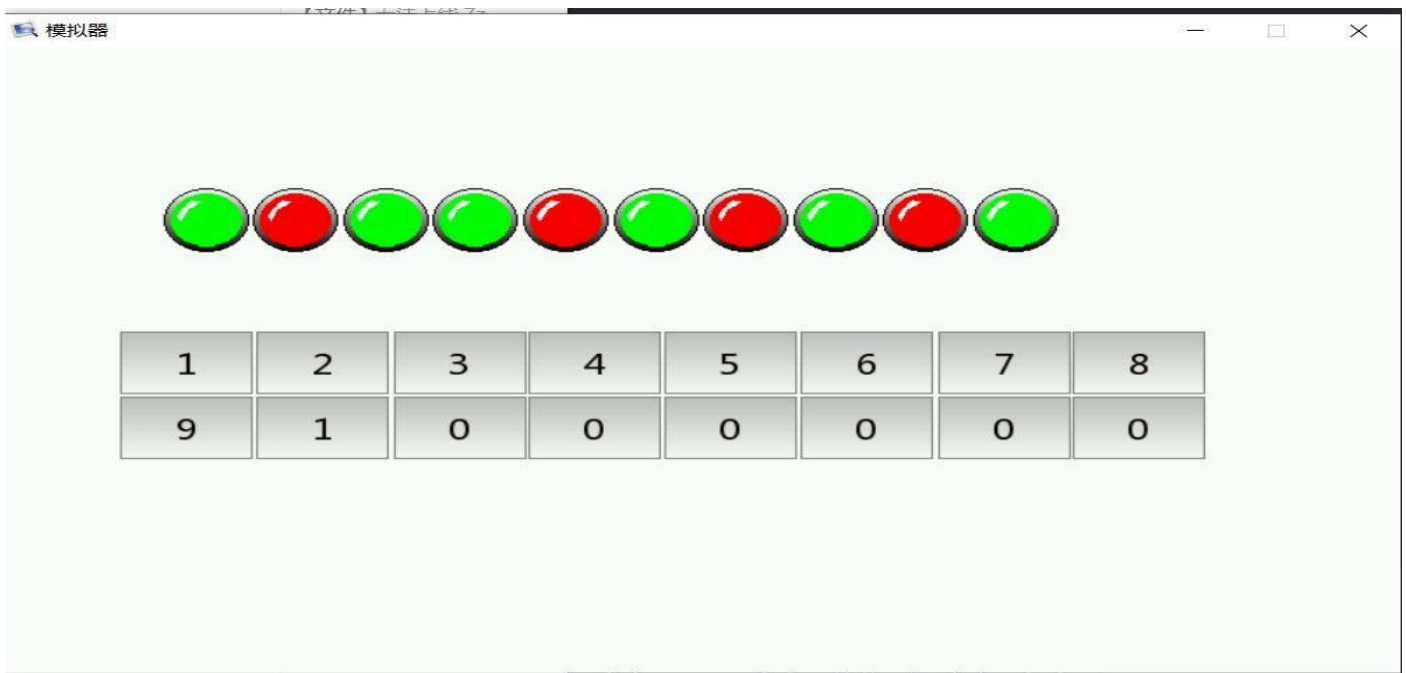


Note: The serial to USB port number in the Device Manager should be the same as the serial port number of the device.

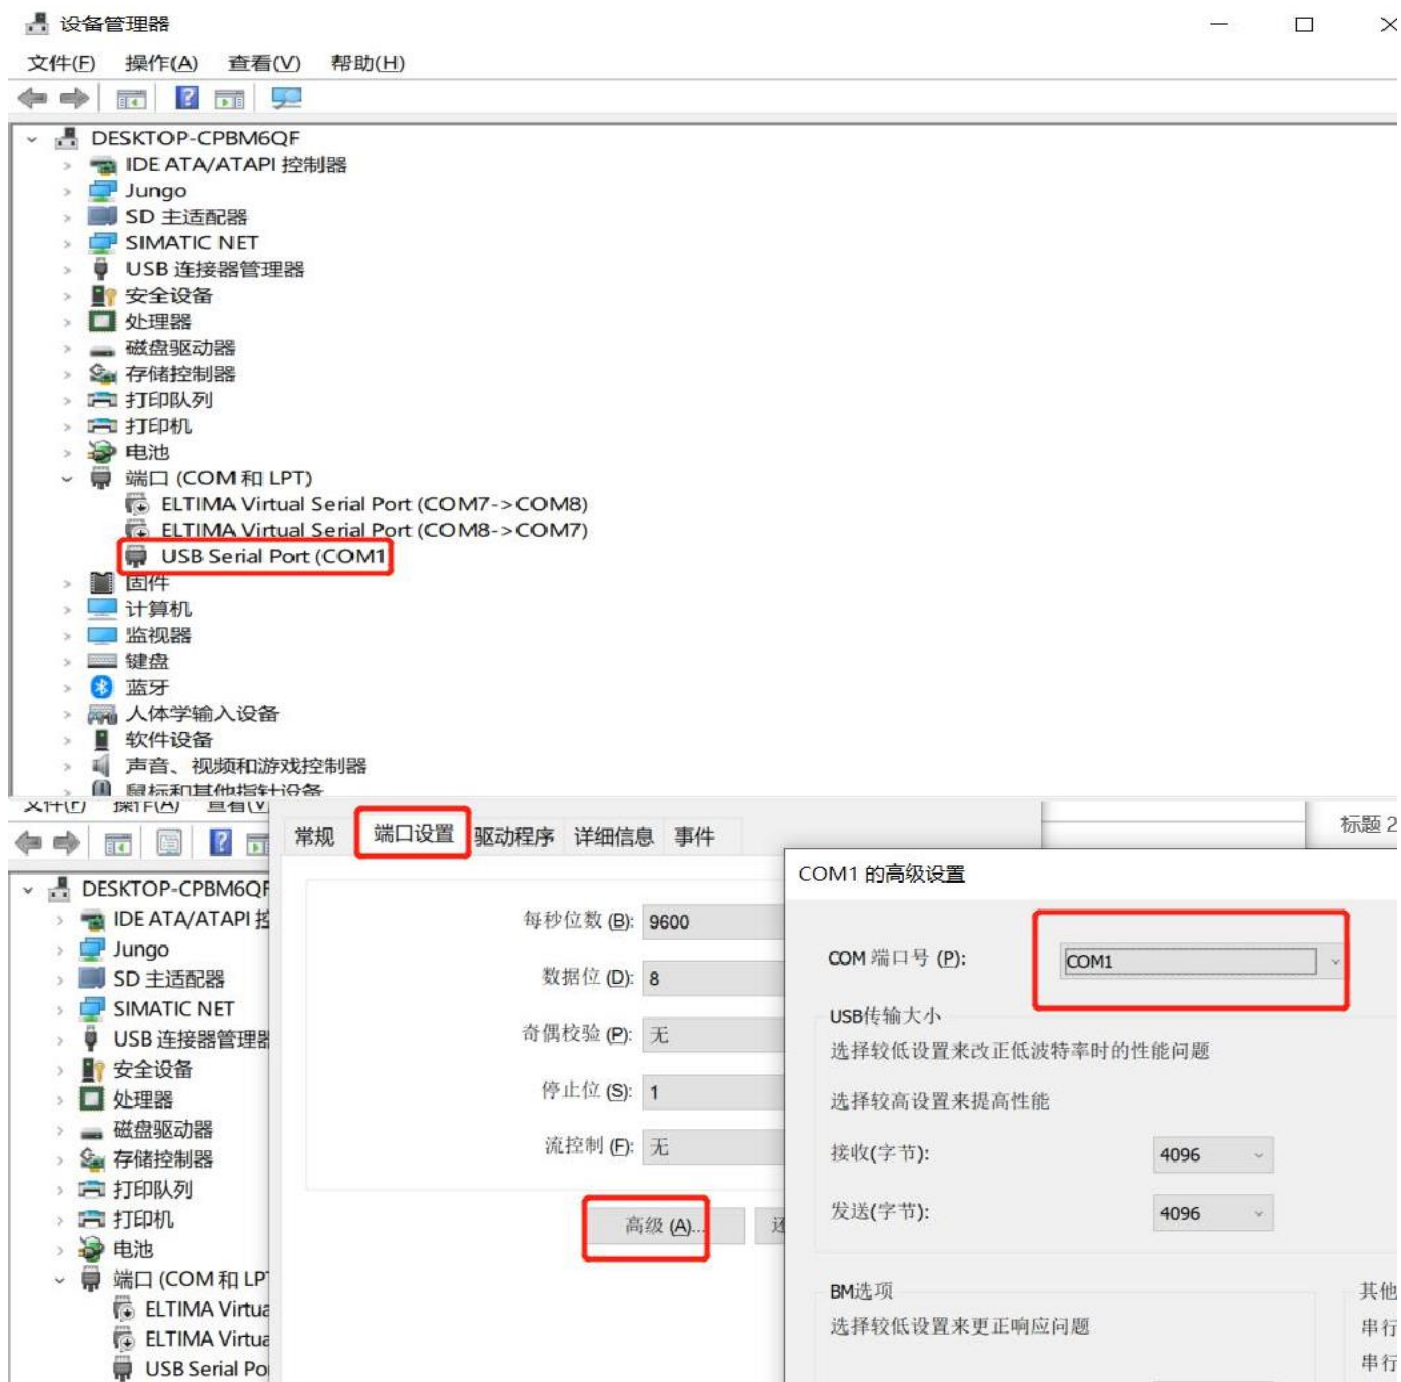



二. Modbus_TCP On-line simulation

1.New project, create a new network PLC Select a modbus tcp device. Add numeric inputs, buttons and other components.

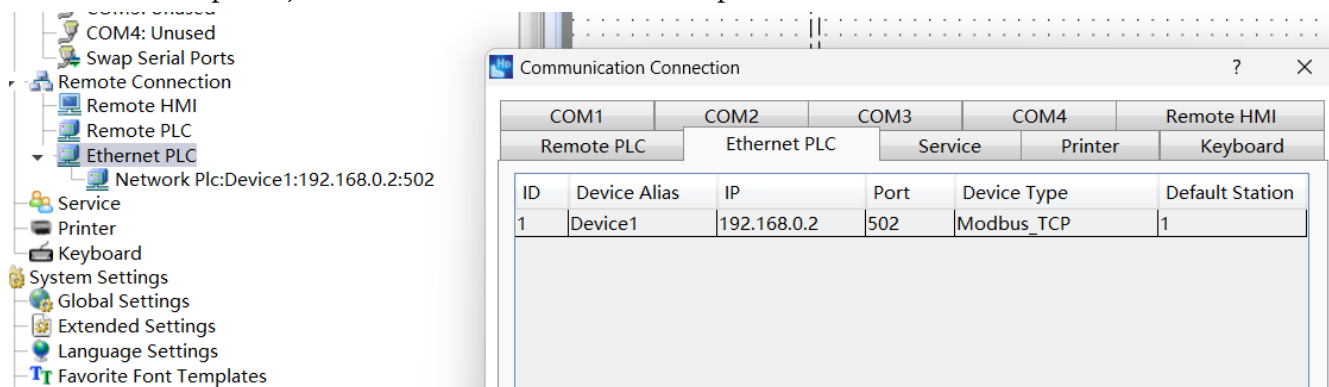

2.After compiling the project, click the Online Simulation button , then you can simulate it online.

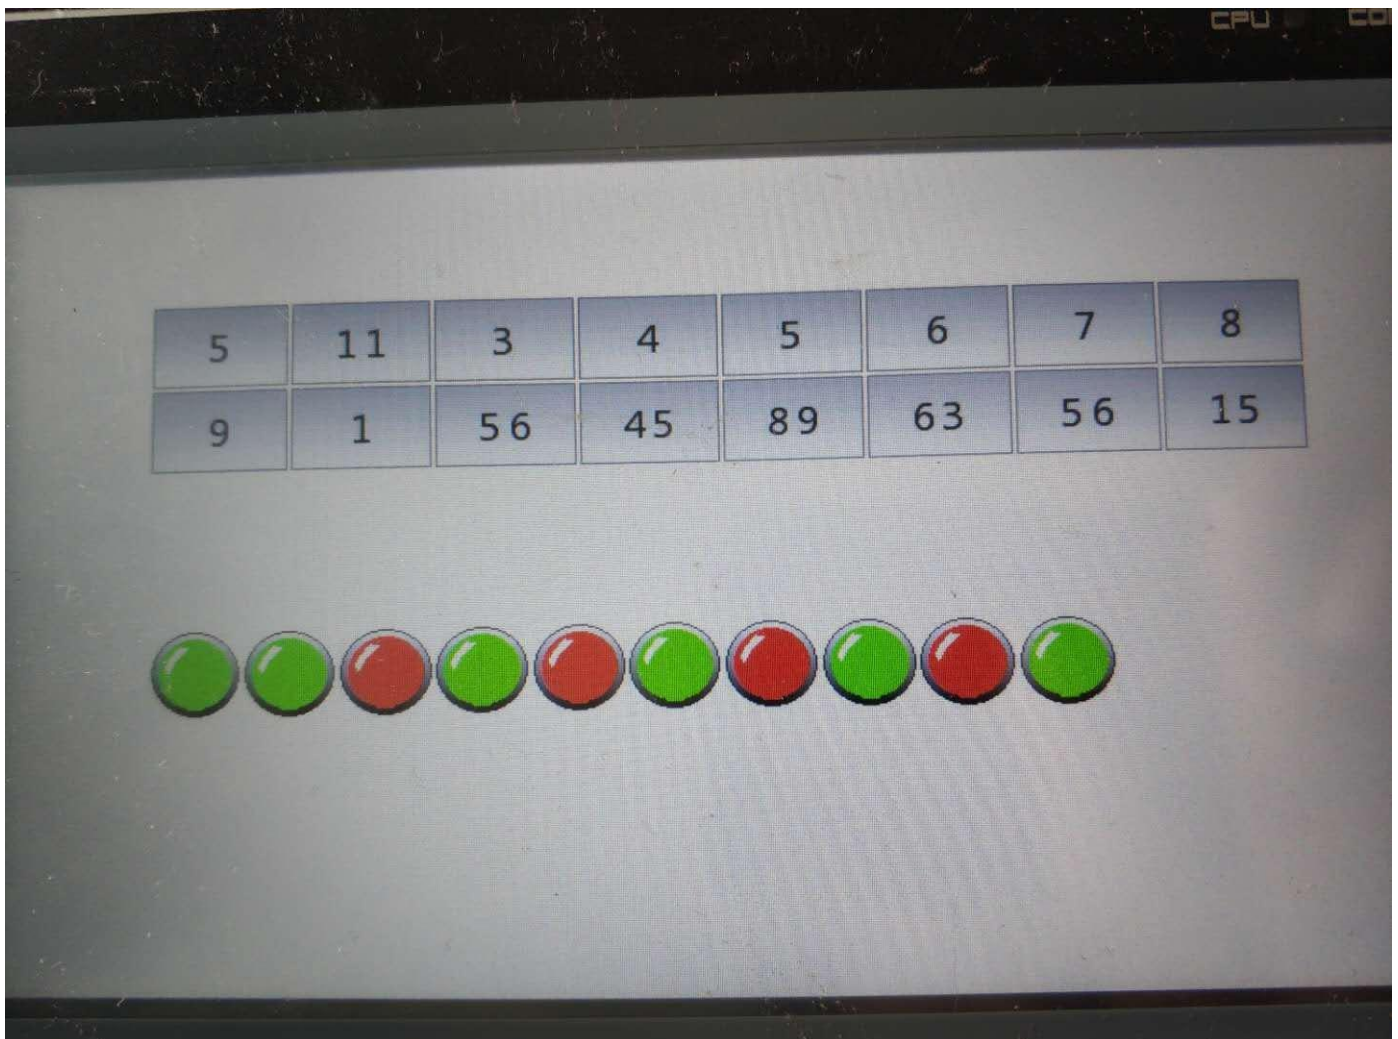

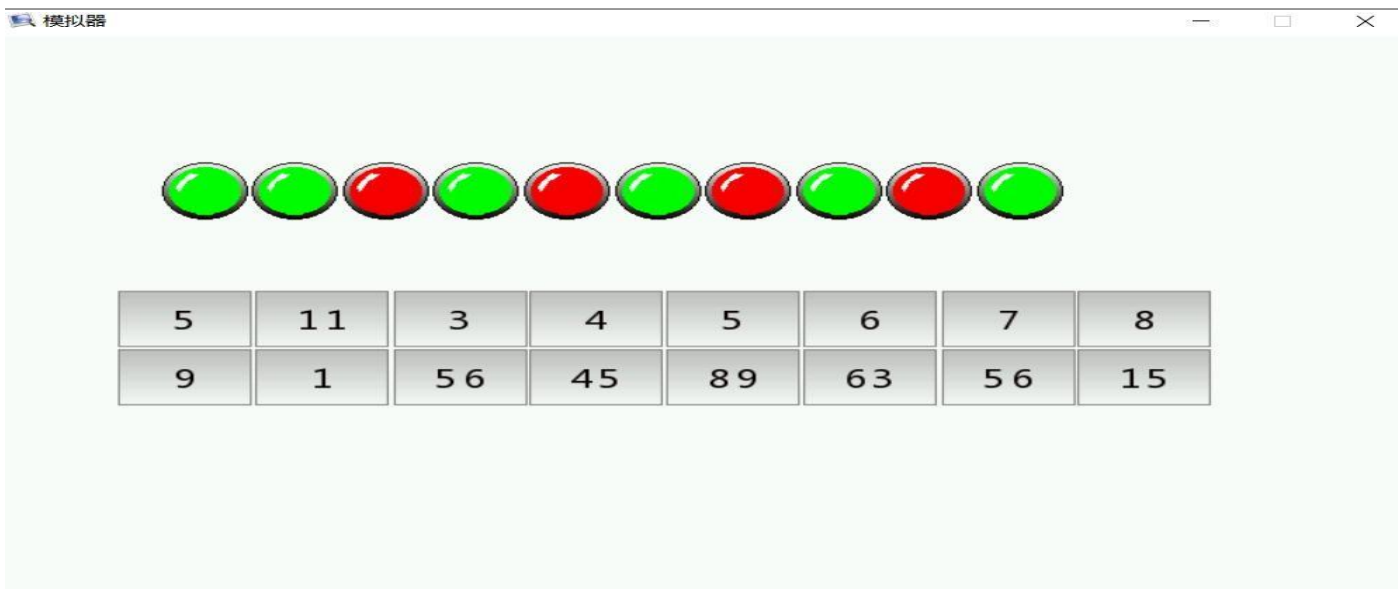

Note: The IP of the network PLC is the IP 192.168.0.200 of the server side of the network device, which needs to be in the same network segment as the IP address 192.168.0.2 of the local machine.

